


Example of Reduced Pressure Principle Backflow Prevention Assembly Installation

**PID to install Service
Line, Meter, Spud & Ball
Valve**



**Customer to install device as close to Ball
Valve as practical. Must not exceed 12"
Unless approved by PID.**

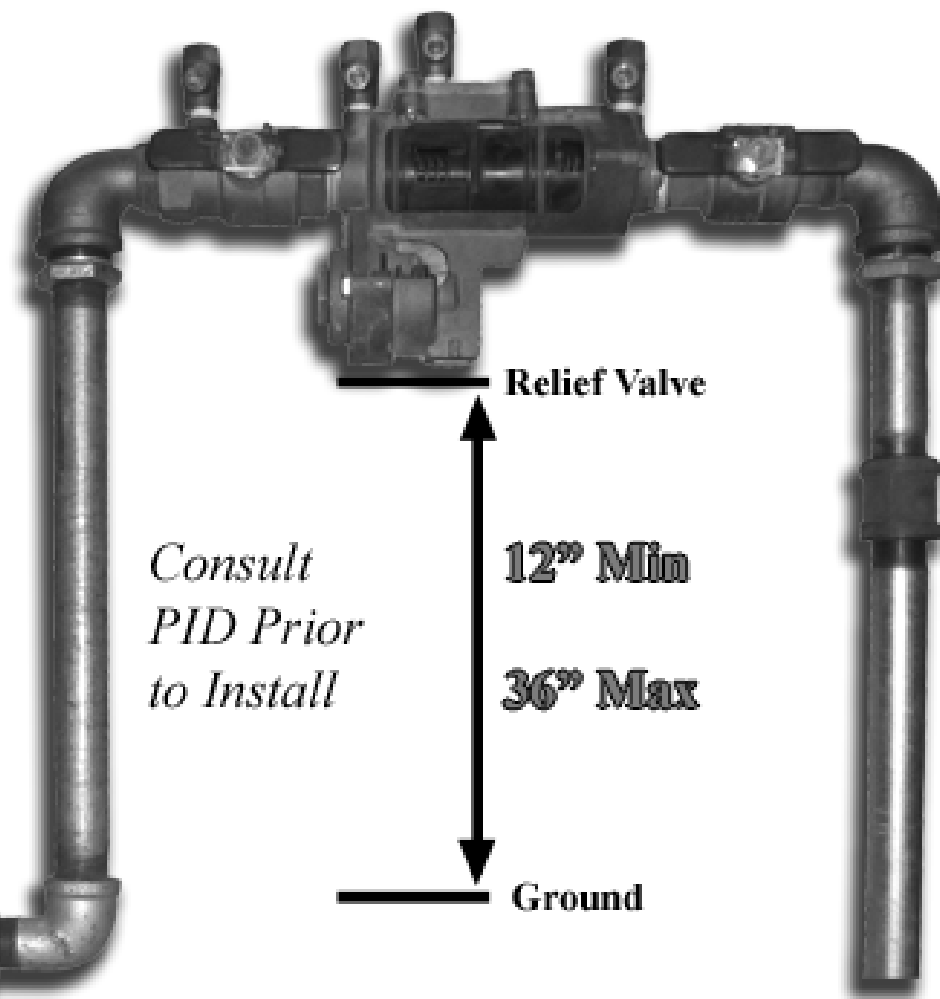

**Device must be constructed or supported in a
manner that reduces movement during
testing and maintenance.**